

Thinknx Integration Kit



A downloadable version of this document is available [here](#).

The purpose of this document is to illustrate how to integrate third party systems with Thinknx servers and its functionalities. Integration can be on different levels depending on the structure of the plant, required system reliability and internet connection availability. Here follows the possible integration scenarios:

- Local based integration – 1 to 1
- Cloud based integration – 1 to 1 or 1 to many
- On premise integration – 1 to many

On the lowest level, the communication between the systems is based on a set of commands based on Representational State Transfer (RESTful API).

After the final commissioning, depending on the kind of plants and integrated devices, all the functionalities created for the end user can be also used by third party services through Thinknx Integration Kit API. It is possible to distinguish several main devices that can be controlled that are the same of the UI elements available from Thinknx Configurator

- Lights, switches and bulbs
- Blinds, curtains and lamellas
- Thermostats
- HVAC units and fans
- Analog values
- Scenes
- Generic Buttons

In addition to these UI objects it is also possible to send command directly to the system and interact with KNX bus without any UI layer. Devices are available only after the creation of the project and its deployment on the server. Each device is identified by a unique identifier (GUID) that can either be read from Configurator or from the dedicated server web page (Server→Integration Kit). When you send content to or making a request to the API, the response will be returned in JSON. JSON is an open standard data format that is lightweight and human-readable, and looks like Objects do in JavaScript; hence the name.

All API access is over HTTP or HTTPS as better specified on the following chapters. HTTP requests will be redirected to HTTPS when possible. HTTP return codes are used to notify a successful request or errors. Possible error status codes are:

- 403 - the authentication information is incorrect.
- 400 - there is an error in the construction of the request. The body of the response will contain more detail of the problem.
- 404 - the requested device could not be found. This may also occur if the user does not have access to the requested device.
- 429 - the request exceeded the rate limit.
- 500 - something went wrong on the server. This error should not occur.

For sake of simplicity, all the calls are performed using GET requests. Also POST requests can be used instead of GET if needed. In this last case use "Content-Type: application/x-www-form-urlencoded" in header to grant maximum compatibility.

Local based integration


The communication between third party service and the server is direct and don't require any internet connection. The third party app can directly authenticate with Thinknx server. Authentication can be Simple Auth or Digest Auth. The server will respond to its IP at port 5051. All the API calls have the following form:

`http://server_IP:5051/api/V1/controller?param1=value1¶m2=value2`

Please note that in this case server will respond only to plain http requests (no https).

Cloud based integration

Thinknx servers are connected through internet to Thinknx Cloud service. Thinknx Cloud service permits to access to the servers independently from the network structure and to remotely control them. Each Thinknx server is identified by its own serial number and by a so called "Integration Kit" key. This key is an alphanumerical code that will be used to route the calls from the Cloud server to the correspondent Thinknx server. The key need to be enabled and generated from the Thinknx server web pages under "Server" tab, "Thinknx Cloud" page. Click on "Enable Integration Kit".

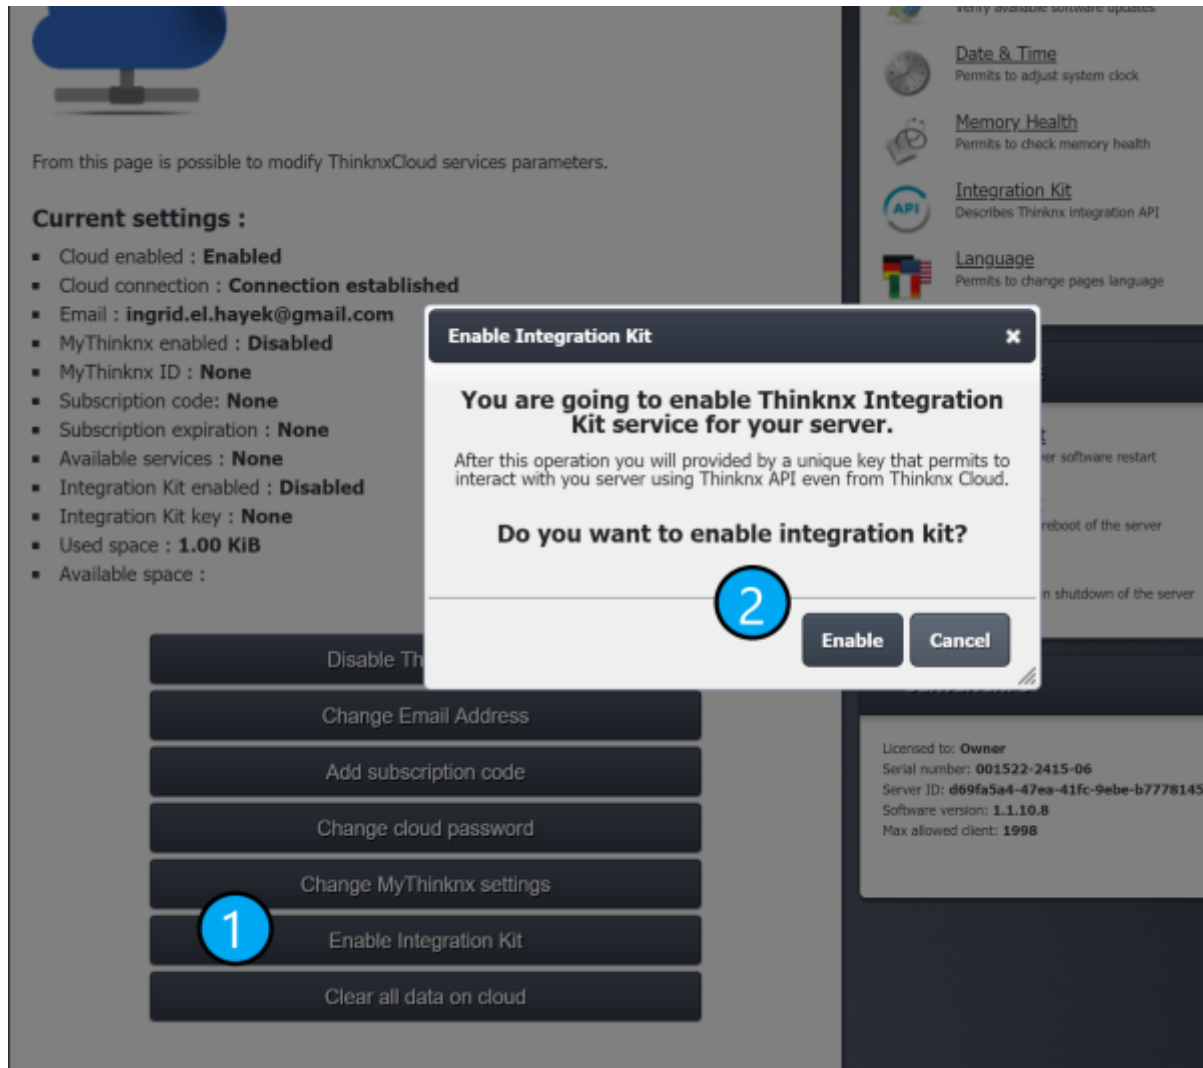

Enable Integration Kit Key

Key permits to directly connect to the server without additional authentication; for this reason it should be kept secret and these precautions should be taken into account while writing code or using cloud based integration:

1. Don't expose key on forms or directly into web pages
2. Don't use key on software that run client side (i.e. javascript pages running on browser)
3. Make all the calls to cloud using https

All the API calls used over cloud have the following form:

`https://data.thinknx.eu/KEY/api/V1/controller?param1=value1¶m2=value2`

HTTP calls will be redirect to HTTPS.

On premise integration

This type of integration is relevant when there is the need to maintains services operational even without internet connection and when it is also important to have contemporary multiple server access. In this case, all the Thinknx Cloud service software can be transferred into a local machine


installed on premise. Thinknx servers will connect to this local machine and also third party service will connect to this machine using the methods described into the Cloud Based Integration.

Devices capabilities

Each device type has its own capabilities that can be operated using the API. Not all capabilities are available to all the devices. Here the list of available capabilities:

- Lights, switches and bulbs
 - Power Controller - Turn a light on or off or get its state
 - PowerLevel Controller - Set or get the power level of an endpoint
- 2. Blinds, curtains and lamellas
 - Movement Controller - Move up, down or stop an endpoint
 - Position Controller - Set or get the position of an endpoint
 - Angle Controller - Set or get or step the angle of an endpoint
- 3. Analog values
 - Value Controller - Set or get a value to an endpoint on a continuous range
- 4. Thermostats
 - Actual temperature Controller - Get the actual temperature for an endpoint
 - Setpoint Controller - Set or get the desired temperature for an endpoint
 - Modality Controller - Set or get the functioning modality for an endpoint
 - Chronotable Controller - Enable or disable chrono scheduling for an endpoint
- 5. HVAC units and fans
 - Power Controller - Turn an endpoint on or off or get its state
 - Setpoint Controller - Set or get the desired temperature for an endpoint
 - Modality Controller - Set or get the functioning modality for an endpoint
 - FanSpeed Controller - Set or get the speed of the fan
- 6. Scenes
 - Launch Controller - Can recall a user recorded scene or stop its execution
- 7. Generic Button
 - Trigger Controller - Can trigger the actions associated with an endpoint

From Thinknx server webpages inside "Server" tab, page "Integration Kit" it is possible to see the entire tree of the project running on the server. Going to the desired object to be controlled is possible to see the supported commands, to simulate them or to copy the URL to be able to send the command remotely.

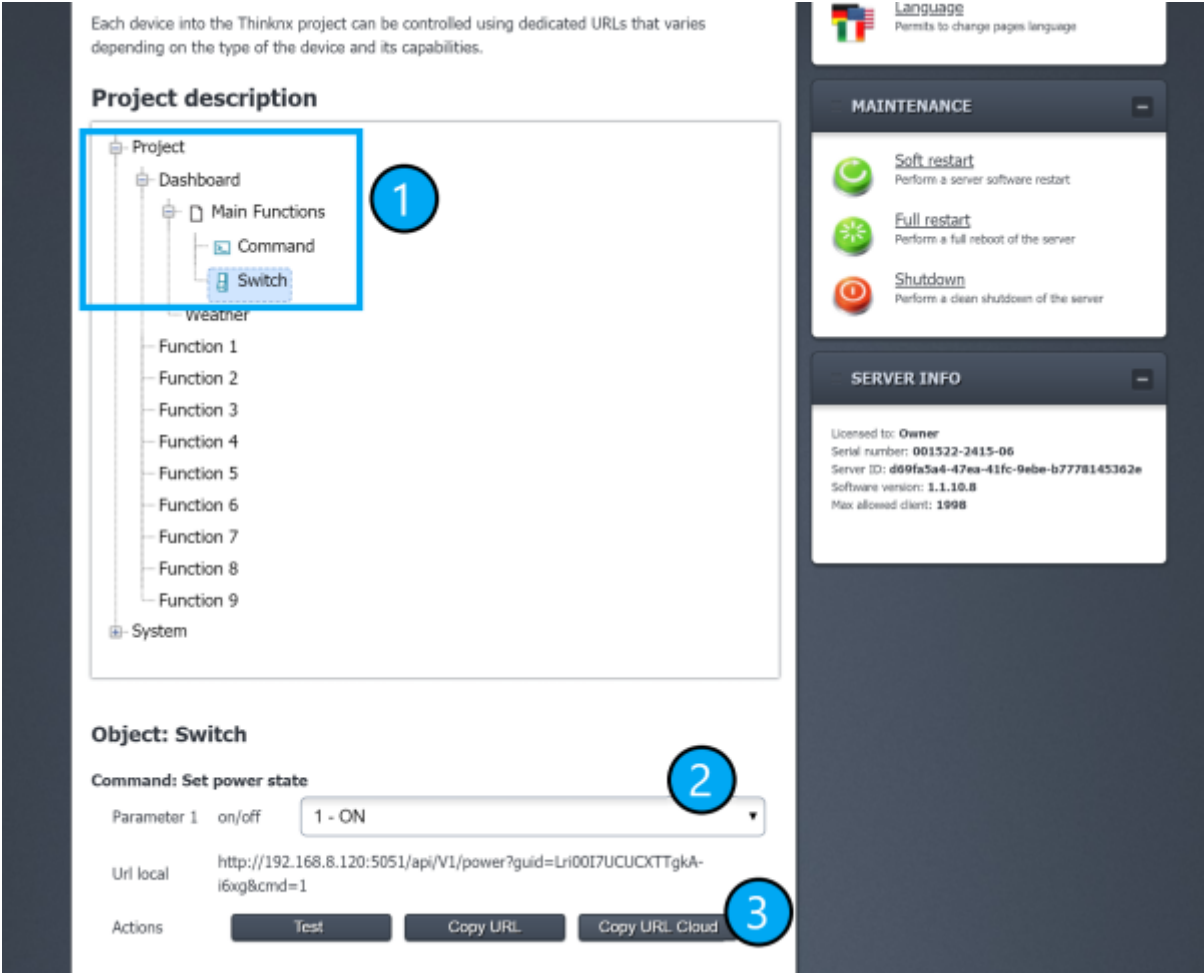

Project tree with API description

Asynchronous events (coming soon)

Thinknx Service can provide events to the third party service thanks to REST hooks. The third party system can define HTTP callbacks to be triggered by predefined events occurring on the devices. HTTP callbacks can be connected to the entire server, a single device or event a device controller.

API URLs

Here follows the list of the API URLs for each device type and its controllers.

Lights, switches and bulbs

Power Controller

Description	Set the status On or Off for a defined switch object
URL	api/v1/power

Description	Set the status On or Off for a defined switch object
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the light to operate to cmd=[0 or 1] where 0 turn off the device whilst 1 turn it on Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "power", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> In case of feedback request (fb parameter present) <pre>{ "namespace" : "power", "guid": [device_identifier], "status" : [0 or 1], "comm_obj" : [obj_num] }</pre> "status" variable value represent actual power status (0=OFF / 1=ON)
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> or <pre>{ "error" : "params errors" }</pre> or <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/power?guid=1lzPszHWAEEuvzxtXBMkzWQ&cmd=1&fb

Power Controller (Status)

Description	Get the status On or Off for a defined switch object
URL	api/v1/powerstatus
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the light to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "powerstatus", "guid": [device_identifier], "status" : [0 or 1], "comm_obj" : [obj_num] }</pre> "status" variable value represent actual power status (0=OFF / 1=ON)

Description	Get the status On or Off for a defined switch object
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> or <pre>{ "error" : "params errors" }</pre> or <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/powerstatus?guid=1IzPszHWAeuvzxtXBMkzWQ

Power Level Controller

Description	Set the power level for a defined switch dimmable object
URL	<i>api/v1/powerlevel</i>
URL Params	<p>guid=device_identifier where "device_identifier" is the string that identifies the light to operate to</p> <p>cmd=[0 to 100] where the number represents the power level (in percentage) to set the for the device</p> <p>Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.</p>
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "powerlevel", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> <p>In case of feedback request (fb parameter present)</p> <pre>{ "namespace" : "powerlevel", "guid": [device_identifier], "status" : [0 to 100], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual power level in percentage</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> or <pre>{ "error" : "params errors" }</pre> or <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/powerlevel?guid=1IzPszHWAeuvzxtXBMkzWQ&&cmd=50&fb

Power Level Controller (Status)

Description	Get the status of power level for a defined dimmable switch object
URL	<i>api/v1/powerlevelstatus</i>
URL Params	<i>guid=device_identifier</i> where "device_identifier" is the string that identifies the light to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "powerlevelstatus", "guid": [device_identifier], "status" : [0 to 100], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual power level in percentage</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found" } or { "error" : "params errors" } or { "error" : "impossible to execute" }</pre>
Example	<i>/api/V1/powerlevelstatus?guid=1lzPszHWAEEuvzxtXBMkzWQ</i>

Blinds, curtains and lamellas

Movement Controller / Up or Down

Description	Move up, down a defined blind or curtain
URL	<i>api/v1/updown</i>
URL Params	<i>guid=device_identifier</i> where "device_identifier" is the string that identifies the device to operate to <i>cmd=[0 or 1]</i> where the number represents the desired movement direction to set the for the device 0=Move UP / 1=Move DOWN
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "updown", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre>
Error Response Code	400 or 404

Description	Move up, down a defined blind or curtain
Error Response Content	<pre>{ "error" : "device not found"}</pre> or <pre>{ "error" : "params errors" }</pre> or <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/updown?guid=1lzPszHWAeuvzxtXBMkzWQ&cmd=1

Movement Controller / Stop

Description	Stop the movement of a defined blind or curtain
URL	api/v1/stop
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to cmd=1 needed to assert the stop command
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "stop", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> or <pre>{ "error" : "params errors" }</pre> or <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/stop?guid=1lzPszHWAeuvzxtXBMkzWQ&cmd=1

Position Controller / Height

Description	Set the height/position of a defined blind or curtain
URL	api/v1/heightlevel
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to cmd=[0 to 100] where the number represents the desired height/position to set the for the device in percentage Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.
Data Params	not required

Description	Set the height/position of a defined blind or curtain
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "heightlevel", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> <p>In case of feedback request (fb parameter present)</p> <pre>{ "namespace" : "heightlevel", "guid": [device_identifier], "status" : [0 to 100], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual height/position in percentage</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/heightlevel?guid=1IzPszHWAEuvzxtXBMkzWQ&&cmd=50&fb

Position Controller / Height (Status)

Description	Get the height/position of a defined blind or curtain
URL	<i>api/v1/heightlevelstatus</i>
URL Params	<i>guid=device_identifier</i> where "device_identifier" is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "heightlevelstatus", "guid": [device_identifier], "status" : [0 to 100], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual height/position in percentage</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/heightlevelstatus?guid=1IzPszHWAEuvzxtXBMkzWQ

Angle Controller / Blind step

Description	Step clockwise or counter-clockwise lamellas of a defined blind
URL	<i>api/v1/blindstep</i>
URL Params	<i>guid=device_identifier</i> where "device_identifier" is the string that identifies the device to operate to <i>cmd=[0 or 1]</i> where the number represents the desired step direction to set the for the device 0 = Step clockwise / 1 = Step counter-clockwise
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	{ "namespace" : "blindstep", "guid": [device_identifier], "comm_obj" : [obj_num] }
Error Response Code	400 or 404
Error Response Content	{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}
Example	<i>/api/V1/blindstep?guid=1IzPszHWAEEuvzxtXBMkzWQ&cmd=1</i>

Angle Controller / Blind angle

Description	Set the angle for the lamellas of a defined blind
URL	<i>api/v1/blindangle</i>
URL Params	<i>guid=device_identifier</i> where "device_identifier" is the string that identifies the device to operate to <i>cmd=[0 to 100]</i> where the number represents the desired angle (in percentage) to set the for the device Optional parameter for set: <i>fb</i> if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.
Data Params	not required
Success Response Code	200 (OK)

Description	Set the angle for the lamellas of a defined blind
Success Response Content	<pre>{ "namespace" : "blindangle", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> <p>In case of feedback request (fb parameter present)</p> <pre>{ "namespace" : "blindangle", "guid": [device_identifier], "status" : [0 to 100], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual angle in percentage</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	<code>/api/V1/blindangle?guid=1IzPszHWAEEuvzxtXBMkzWQ&&cmd=50&fb</code>

Angle Controller / Blind angle (Status)

Description	Get the angle for the lamellas of a defined blind
URL	<code>api/v1/blindanglestatus</code>
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "blindanglestatus", "guid": [device_identifier], "status" : [0 to 100], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual angle in percentage</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	<code>/api/V1/blindanglestatus?guid=1IzPszHWAEEuvzxtXBMkzWQ</code>

Analog values

Analog controller / Value

Description	Set the desired value for a defined “analog value” device
URL	<i>api/v1/setvalue</i>
URL Params	guid=device_identifier where “device_identifier” is the string that identifies the device to operate to cmd=[new_value] where “new_value” represent the desired value to set. Number can be in decimal format with ‘.’ as decimal separator Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "setvalue", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> In case of feedback request (fb parameter present) <pre>{ "namespace" : "setvalue", "guid": [device_identifier], "status" : [actual_value], "comm_obj" : [obj_num] }</pre> “status” variable value represent actual value
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found" }</pre> or <pre>{ "error" : "params errors" }</pre> or <pre>{ "error" : "impossible to execute" }</pre>
Example	<i>/api/V1/setvalue?guid=1IzPszHWAEuvzxtXBMkzWQ&&cmd=85.325&fb</i>

Analog controller / Value (Status)

Description	Get the actual value for a defined “analog value” device
URL	<i>api/v1/getvalue</i>
URL Params	guid=device_identifier where “device_identifier” is the string that identifies the device to operate to
Data Params	not required

Description	Get the actual value for a defined “analog value” device
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "getvalue", "guid": [device_identifier], "status" : [actual_value], "comm_obj" : [obj_num] }</pre> <p>“status” variable value represent actual value</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/getvalue?guid=1lzPszHWAEEuvzxtXBMkzWQ

Thermostats

Thermostat Controller / Actual temperature

Description	Get the actual measured temperature for a defined thermostat
URL	<i>api/v1/actualtemp</i>
URL Params	guid=device_identifier where “device_identifier” is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "actualtemp", "guid": [device_identifier], "status" : [actual_temperature], "comm_obj" : [obj_num] }</pre> <p>“status” variable value represent actual temperature</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/actualtemp?guid=1lzPszHWAEEuvzxtXBMkzWQ

Thermostat Controller / Setpoint

Description	Set the desired setpoint temperature for a thermostat
URL	<i>api/v1/setpoint</i>
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to cmd=[new_setpoint] where "new_setpoint" represent the desired temperature. Number can be in decimal format with '.' as decimal separator Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "setpoint", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> In case of feedback request (fb parameter present) <pre>{ "namespace" : "setpoint", "guid": [device_identifier], "status" : [actual_setpoint], "comm_obj" : [obj_num] }</pre> "status" variable value represent actual setpoint
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> or <pre>{ "error" : "params errors" }</pre> or <pre>{ "error" : "impossible to execute"}</pre>
Example	<i>/api/V1/setpoint?guid=1lzPszHWAEEuvzxtXBMkzWQ&&cmd=20.5&fb</i>

Thermostat Controller / Setpoint (Status)

Description	Get the actual setpoint temperature for a thermostat
URL	<i>api/v1/setpointstatus</i>
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)

Description	Get the actual setpoint temperature for a thermostat
Success Response Content	<pre>{ "namespace" : "setpointstatus", "guid": [device_identifier], "status" : [actual_setpoint], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual setpoint</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/setpointstatus?guid=1IzPszHWAeUvzxtXBMkzWQ

Thermostat Controller / Modality

Description	Set the desired modality for a thermostat
URL	api/v1/tempmode
URL Params	<p>guid=device_identifier where "device_identifier" is the string that identifies the device to operate to cmd=[new_mode] where "new_mode" represent the desired operating modality using the following numbers: 0 = standby 1 = comfort 2 = night/economy 3 = frost/heat protection Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.</p>
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "tempmode", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> <p>In case of feedback request (fb parameter present)</p> <pre>{ "namespace" : "tempmode", "guid": [device_identifier], "status" : [actual_mode], "comm_obj" : [obj_num] }</pre> <p>"status" variable values meaning are same as the ones of the request</p>

Description	Set the desired modality for a thermostat
Error Response Code	400 or 404
Error Response Content	{ "error" : "device not found" } or { "error" : "params errors" } or { "error" : "impossible to execute" }
Example	/api/V1/tempmode?guid=1IzPszHWAEEuvzxtXBMkzWQ&cmd=1&fb

Thermostat Controller / Modality (Status)

Description	Get the actual modality for a thermostat
URL	api/v1/tempmodestatus
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	{ "namespace" : "tempmodestatus", "guid": [device_identifier], "status" : [actual_mode], "comm_obj" : [obj_num] } "status" variable values will be as follow: 0 = standby 1 = comfort 2 = night/economy 3 = frost/heat protection
Error Response Code	400 or 404
Error Response Content	{ "error" : "device not found" } or { "error" : "params errors" } or { "error" : "impossible to execute" }
Example	/api/V1/tempmodestatus?guid=1IzPszHWAEEuvzxtXBMkzWQ

Thermostat Controller / Chronoscheduling

Description	Enable/Disable the chronoscheduling for a defined thermostat
URL	api/v1/chronoen

Description	Enable/Disable the chronoscheduling for a defined thermostat
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to cmd=[0 or 1] where 0 disable the chronoscheduling whilst 1 enable it Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "chronoen", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> In case of feedback request (fb parameter present) <pre>{ "namespace" : "chronoen", "guid": [device_identifier], "status" : [0 or 1], "comm_obj" : [obj_num] }</pre> "status" variable value represent actual chronoscheduling enable status (0=Disabled / 1=Enabled)
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> or <pre>{ "error" : "params errors" }</pre> or <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/chronoen?guid=1IzPszHWAEEuvzxtXBMkzWQ&cmd=1&fb

Thermostat Controller / Chronoscheduling (Status)

Description	Get the status of chronoscheduling for a defined thermostat
URL	api/v1/chronoenstatus
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)

Description	Get the status of chronoscheduling for a defined thermostat
Success Response Content	<pre>{ "namespace" : "chronoenstatus", "guid": [device_identifier], "status" : [0 or 1], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual chronoscheduling enable status (0=Disabled / 1=Enabled)</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/chronoenstatus?guid=1lzPszHWAEEuvzxtXBMkzWQ

HVAC units and fans

HVAC Controller / Powering

Description	Set the desired power state for a defined HVAC device
URL	api/v1/hvacpower
URL Params	<p>guid=device_identifier where "device_identifier" is the string that identifies the device to operate to cmd=[0 or 1] where 0 turn off the device whilst 1 turn it on Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.</p>
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "hvacpower", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> <p>In case of feedback request (fb parameter present)</p> <pre>{ "namespace" : "hvacpower", "guid": [device_identifier], "status" : [0 or 1], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual power status for the device (0=OFF / 1=ON)</p>

Description	Set the desired power state for a defined HVAC device
Error Response Code	400 or 404
Error Response Content	{ "error" : "device not found" } or { "error" : "params errors" } or { "error" : "impossible to execute" }
Example	/api/V1/hvacpower?guid=1lzPszHWAEEuvzxtXBMkzWQ&cmd=1&fb

HVAC Controller / Powering (Status)

Description	Get the actual power state for a defined HVAC device
URL	api/v1/hvacpowerstatus
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	{ "namespace" : "hvacpowerstatus", "guid": [device_identifier], "status" : [0 or 1], "comm_obj" : [obj_num] } "status" variable value represent actual power status for the device (0=OFF / 1=ON)
Error Response Code	400 or 404
Error Response Content	{ "error" : "device not found" } or { "error" : "params errors" } or { "error" : "impossible to execute" }
Example	/api/V1/hvacpowerstatus?guid=1lzPszHWAEEuvzxtXBMkzWQ

HVAC Controller / Setpoint

Description	Set the desired setpoint temperature for a defined HVAC device
URL	api/v1/hvacsetpoint
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to cmd=[new_setpoint] where "new_setpoint" represent the desired temperature. Number can be in decimal format with '.' as decimal separator Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.

Description	Set the desired setpoint temperature for a defined HVAC device
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "hvacsetpoint", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> <p>In case of feedback request (fb parameter present)</p> <pre>{ "namespace" : "hvacsetpoint", "guid": [device_identifier], "status" : [actual_setpoint], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual setpoint</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/hvacsetpoint?guid=1IzPszHWAEuvzxtXBMkzWQ&&cmd=20.5&fb

HVAC Controller / Setpoint (Status)

Description	Get the actual setpoint temperature for a defined HVAC device
URL	<i>api/v1/hvacsetpointstatus</i>
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "hvacsetpointstatus", "guid": [device_identifier], "status" : [actual_setpoint], "comm_obj" : [obj_num] }</pre> <p>"status" variable value represent actual setpoint</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>

Description	Get the actual setpoint temperature for a defined HVAC device
Example	/api/V1/hvacsetpointstatus?guid=1lzPszHWAEuvzxtXBMkzWQ

HVAC Controller / Modality

Description	Set the desired modality for a defined HVAC device
URL	<i>api/v1/hvacmode</i>
URL Params	<p>guid=<i>device_identifier</i> where "device_identifier" is the string that identifies the device to operate to cmd=<i>[new_mode]</i> where "new_mode" represent the desired operating modality using the following numbers: 0 = Cooling 1 = Heating 2 = Dry 3 = Fan 4 = Auto Optional parameter for set: fb if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.</p>
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "hvacmode", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> <p>In case of feedback request (fb parameter present)</p> <pre>{ "namespace" : "hvacmode", "guid": [device_identifier], "status" : [actual_mode], "comm_obj" : [obj_num] }</pre> <p>"status" variable values meaning are same as the ones of the request</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found" }</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute" }</pre>
Example	/api/V1/hvacmode?guid=1lzPszHWAEuvzxtXBMkzWQ&cmd=1&fb

HVAC Controller / Modality (Status)

Description	Get the actual modality for a defined HVAC device
URL	<i>api/v1/hvacmodestatus</i>
URL Params	<i>guid=device_identifier</i> where “device_identifier” is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "hvacmodestatus", "guid": [device_identifier], "status" : [actual_mode], "comm_obj" : [obj_num] }</pre> <p>“status” variable values will be as follow: 0 = Cooling 1 = Heating 2 = Dry 3 = Fan 4 = Auto</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	<i>/api/V1/hvacmodestatus?guid=1lzPsZHWAEuvzxtXBMkzWQ</i>

HVAC Controller / Fan speed

Description	Set the desired fan speed for a defined HVAC device
URL	<i>api/v1/hvacfan</i>
URL Params	<i>guid=device_identifier</i> where “device_identifier” is the string that identifies the device to operate to <i>cmd=[new_speed]</i> where “new_speed” represent the desired fan speed using the following numbers: 0 = Auto 1 = Minimum speed 2 = Average speed 3 = Maximum speed Optional parameter for set: <i>fb</i> if the parameter is present the server will suspend the reply and will wait for the feedback from the operated device.
Data Params	not required
Success Response Code	200 (OK)

Description	Set the desired fan speed for a defined HVAC device
Success Response Content	<pre>{ "namespace" : "hvacfan", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre> <p>In case of feedback request (fb parameter present)</p> <pre>{ "namespace" : "hvacfan", "guid": [device_identifier], "status" : [actual_speed], "comm_obj" : [obj_num] }</pre> <p>"status" variable values meaning are same as the ones of the request</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>
Example	/api/V1/hvacfan?guid=1lzPszHWAEEuvzxtXBMkzWQ&cmd=2&fb

HVAC Controller / Fan speed (Status)

Description	Get the actual fan speed for a defined HVAC device
URL	api/v1/hvacfanstatus
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the device to operate to
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "hvacfanstatus", "guid": [device_identifier], "status" : [actual_speed], "comm_obj" : [obj_num] }</pre> <p>"status" variable values will be as follow: 0 = Auto 1 = Minimum speed 2 = Average speed 3 = Maximum speed</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"}</pre> <p>or</p> <pre>{ "error" : "params errors" }</pre> <p>or</p> <pre>{ "error" : "impossible to execute"}</pre>

Description	Get the actual fan speed for a defined HVAC device
Example	/api/V1/hvacfanstatus?guid=1lzPszHWAeuvzxtXBMkzWQ

Scenes

Scene controller / Scene launch

Description	Launch or stop the execution of a defined scene
URL	api/v1/scenelaunch
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the scene to operate to cmd=[0 or 1] where 0 stops the execution of a running scene whilst 1 launches it Attention: A running scene is a scene with operations that are not executed instantly (e.g. pauses between single operations). Scenes don't have a state (on or off) but are intended just as a macro i.e. a list of operations to perform.
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	{ "namespace" : "scenelaunch", "guid": [device_identifier], "comm_obj" : [obj_num] }
Error Response Code	400 or 404
Error Response Content	{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}
Example	/api/V1/scenelaunch?guid=1lzPszHWAeuvzxtXBMkzWQ&cmd=1

Generic Button

Generic Button controller / Operation trigger

Description	Trigger the operation associated to a defined generic button
URL	api/v1/trigger
URL Params	guid=device_identifier where "device_identifier" is the string that identifies the generic button to operate to
Data Params	not required
Success Response Code	200 (OK)

Description	Trigger the operation associated to a defined generic button
Success Response Content	<pre>{ "namespace" : "trigger", "guid": [device_identifier], "comm_obj" : [obj_num] }</pre>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}</pre>
Example	<code>/api/V1/trigger?guid=1IzPszHWAeuvzxtXBMkzWQ&cmd=1</code>

System commands

System controller / Send KNX telegram DPT1

Description	Set a KNX telegram with datatype DPT1 (bit)
URL	<code>api/v1/system/sendKNXbit</code>
URL Params	group=[KNX_group_address] where "KNX_group_address" is KNX group to operate to value=[0 or 1] value to send to KNX bus at the specified group address
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "system/sendKNXbit", "group": [KNX_group_address], "value" : [value_sent] }</pre>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}</pre>
Example	<code>/api/V1/system/sendKNXbit?group=1/0/1&value=0</code>

System controller / Send KNX telegram DPT3 / DPT2

Description	Set a KNX telegram with datatype DPT3 / DPT2 (4 bits)
URL	<code>api/v1/system/sendKNX4bits</code>
URL Params	group=[KNX_group_address] where "KNX_group_address" is KNX group to operate to value=[0 to 31] value to send to KNX bus at the specified group address
Data Params	not required

Description	Set a KNX telegram with datatype DPT3 / DPT2 (4 bits)
Success Response Code	200 (OK)
Success Response Content	{ "namespace" : "system/sendKNX4bits", "group": [KNX_group_address], "value" : [value_sent] }
Error Response Code	400 or 404
Error Response Content	{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}
Example	/api/V1/system/sendKNX4bits?group=1/0/1&value=30

System controller / Send KNX telegram DPT5

Description	Set a KNX telegram with datatype DPT5 (1 byte unsigned)
URL	api/v1/system/sendKNXbyte
URL Params	group=[KNX_group_address] where "KNX_group_addres" is KNX group to operate to value=[0 to 255] value to send to KNX bus at the specified group address
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	{ "namespace" : "system/sendKNXbyte", "group": [KNX_group_address], "value" : [value_sent] }
Error Response Code	400 or 404
Error Response Content	{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}
Example	/api/V1/system/sendKNXbyte?group=1/0/1&value=30

System controller / Send KNX telegram DPT6

Description	Set a KNX telegram with datatype DPT6 (1 byte signed)
URL	api/v1/system/sendKNXbyteun
URL Params	group=[KNX_group_address] where "KNX_group_addres" is KNX group to operate to value=[-128 to 127] value to send to KNX bus at the specified group address
Data Params	not required
Success Response Code	200 (OK)

Description	Set a KNX telegram with datatype DPT6 (1 byte signed)
Success Response Content	<pre>{ "namespace" : "system/sendKNXbyteun", "group": [KNX_group_address], "value" : [value_sent] }</pre>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}</pre>
Example	<code>/api/V1/system/sendKNXbyteun?group=1/0/1&value=30</code>

System controller / Send KNX telegram DPT9

Description	Set a KNX telegram with datatype DPT9 (2 bytes floating point)
URL	<code>api/v1/system/sendKNXfloat2bytes</code>
URL Params	group=[KNX_group_address] where "KNX_group_addres" is KNX group to operate to value=[new_value] value to send to KNX bus at the specified group address
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "system/sendKNXfloat2bytes", "group": [KNX_group_address], "value" : [value_sent] }</pre>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}</pre>
Example	<code>/api/V1/system/sendKNXfloat2bytes?group=1/0/1&value=85.235</code>

System controller / Send KNX telegram DPT14

Description	Set a KNX telegram with datatype DPT14 (4 bytes floating point)
URL	<code>api/v1/system/sendKNXfloat4bytes</code>
URL Params	group=[KNX_group_address] where "KNX_group_addres" is KNX group to operate to value=[new_value] value to send to KNX bus at the specified group address
Data Params	not required

Description	Set a KNX telegram with datatype DPT14 (4 bytes floating point)
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "system/sendKNXfloat4bytes", "group": [KNX_group_address], "value" : [value_sent] }</pre>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}</pre>
Example	/api/V1/system/sendKNXfloat4bytes?group=1/0/1&value=85.235

System controller / Get server status

Description	Get the most important information from server
URL	<i>api/v1/system/serverStatus</i>
URL Params	not required
Data Params	not required
Success Response Code	200 (OK)
Success Response Content	<pre>{ "namespace" : "system/serverStatus", "version": [software_version], "process_uptime": [process_uptime], "server_uptime" : [server_uptime] "config_time": [config_time], "connected_clients": [connected_clients], "pbx_users": [connected_pbx_users] }</pre> <p>Where:</p> <p>software_version = version of the server firmware in the format "xx.xx.xx.xx"</p> <p>process_uptime = time from last server software restart in the format "X days X hours X min"</p> <p>server_uptime = time from last server full reboot/repower in the format "X days X hours X min"</p> <p>config_time = timestamp of the running configuration in the format "hh:mm:ss YYYY-MM-DD"</p> <p>connected_clients = number of active clients connection as number</p> <p>connected_pbx_users = identifiers of active connected PBX users separated by commas</p>
Error Response Code	400 or 404
Error Response Content	<pre>{ "error" : "device not found"} or { "error" : "params errors" } or { "error" : "impossible to execute"}</pre>

Description	Get the most important information from server
Example	/api/V1/system/serverStatus

From:

<http://www.thinknx.com/wiki/> - Learning Thinknx

Permanent link:

http://www.thinknx.com/wiki/doku.php?id=integration_kit&rev=1575395992

Last update: **2019/12/03 18:59**

